



НҮҮРСНИЙ ОВООЛГЫН ҮЗҮҮЛЭЛТ

№ ETT_SP_SSC



ISO 45001:2018



ISO 9001:2015



ISO 14001:2015



НҮҮРСНИЙ ОВООЛГЫН ЧАНАРЫН ДУНДАЖ ҮЗҮҮЛЭЛТ

<p>НИЙТ ЧИЙГ (ar)</p> <p>≤5.0%</p>	<p>ҮНСЛЭГ (db)</p> <p>≤9.0%</p>	<p>ДЭГДЭМХИЙ (daf)</p> <p>>28.0-37.0%</p>
<p>НИЙТ ХҮХЭР (db)</p> <p>≤1.0%</p>	<p>БАРЬЦАЛДАХ ЧАНАР</p> <p>≥75.0</p>	<p>НҮҮРСНИЙ ХЭМЖЭЭ</p> <p>128.0</p> <p>МЯН.ТН</p>

НҮҮРСНИЙ ОВООЛГЫН ШИНЖИЛГЭЭНИЙ ҮР ДҮН

ALS GROUP LLC
Mongol National Building, 19rd floor,
Chinggis Avenue, Khan-Uul District,
Ulaanbaatar, Mongolia
Tel: +976 70 00787



CERTIFICATE OF ANALYSIS
25L134L158L192L198L219L243L293-TT

CLIENT: Erdene Tavan Tolgoi JSC
ADDRESS: Finance Center, Jgkhjyn-8
Tsi Khiron, Chinggisai District
Ulaanbaatar, Mongolia
ATTN: Galtysa.B
PROJECT NO. xxx
LAB. JOB NO. 25L134L158L192L198L219L243L293-TT
NO. SAMPLES: 10
Notes/Comments: xxx

SAMPLES RECEIVED: 9/12/2025 17/12/2025
INSTRUCTIONS RECEIVED: 9/12/2025 17/12/2025
DATE OF REPORT: 10/12/2025 18/12/2025
STATUS OF REPORT: FINAL
ANALYSIS COMPLETE: 10/12/2025 18/12/2025
PREPARATION CODE: CSP9C, CSPC, CSPG
ANALYSIS CODE: 1.1, COOKING COAL
TSUL, GSN, CBN




These test results are representative only of the sample received in the laboratory.

LAB NO.	SAMPLE NO.	AS RECEIVED BASIS										AIR DRIED BASIS										Crosstite Swelling Number (CSN)	Coal Caking Index (CCI)
		Total Moisture (TM)	Ash (ASH)	Volatiles Matter (VOL)	Fixed Carbon	Total Sulphur (TSUL)	Molature (NOIS)	Ash (ASH)	Volatiles Matter (VOL)	Fixed Carbon	Total Sulphur (TSUL)	Ash (ASH)	Volatiles Matter (VOL)	Fixed Carbon	Total Sulphur (TSUL)	Ash (ASH)	Volatiles Matter (VOL)	Fixed Carbon	Total Sulphur (TSUL)				
1	25353409	7.68	7.49	30.88	53.95	0.57	1.28	8.01	32.02	57.69	0.61	8.11	33.45	58.64	0.62	34.41	63.59	0.67	7.0	86			
2	25354199	7.13	8.11	30.82	53.94	0.66	1.01	8.64	32.85	57.50	0.70	8.73	33.19	58.08	0.71	36.36	63.64	0.78	7.0	88			
3	25357311	7.44	8.31	33.68	55.56	0.50	1.27	8.53	32.93	59.27	0.66	8.58	36.39	60.03	0.67	37.74	62.36	1.00	7.5	94			
4	25357412	7.32	7.01	31.61	54.66	0.53	1.05	7.48	33.11	58.36	0.57	7.56	33.46	58.98	0.58	36.20	63.80	0.62	7.0	89			
5	25359813	5.73	9.79	30.79	53.69	0.58	0.96	10.38	32.35	56.41	0.61	10.38	32.66	56.96	0.61	36.45	63.55	0.68	7.0	85			
6	25359913	5.60	7.08	32.38	54.94	0.65	0.97	7.43	33.97	57.24	0.68	7.50	34.30	58.20	0.68	37.08	62.92	0.74	7.0	89			
7	25361814	6.02	5.92	32.03	56.03	0.81	1.20	6.23	33.67	58.90	0.85	6.30	34.08	59.62	0.86	36.37	63.63	0.92	7.0	91			
8	25361914	5.71	6.35	32.12	55.83	0.57	1.08	6.66	33.69	58.57	0.60	6.73	34.06	59.21	0.61	36.52	63.48	0.65	7.0	82			
9	25366717	4.13	6.25	32.49	56.11	0.56	1.14	6.45	34.54	57.87	0.57	6.52	34.94	58.54	0.58	37.38	62.62	0.62	7.5	91			
10	25366817	4.17	7.47	32.88	55.48	0.65	1.16	7.10	33.91	57.23	0.67	7.19	34.21	57.90	0.68	37.21	62.79	0.74	7.0	87			

QUALITY ASSURANCE/QUALITY CONTROL DATA

STANDARD/MS-41/23	ASH	VOL	TSUL
Certified Value	31.73	20.81	62.68
Standard Deviation	0.069	0.076	0.059
Unit	%	%	%
Analyzed value	10.89	20.58	6.64

This is the Final Report and represents any preliminary report with this Certificate number. Results apply to samples as submitted. All pages of this report have been checked and approved for release. COPY REPORT PROTECTED DOCUMENT

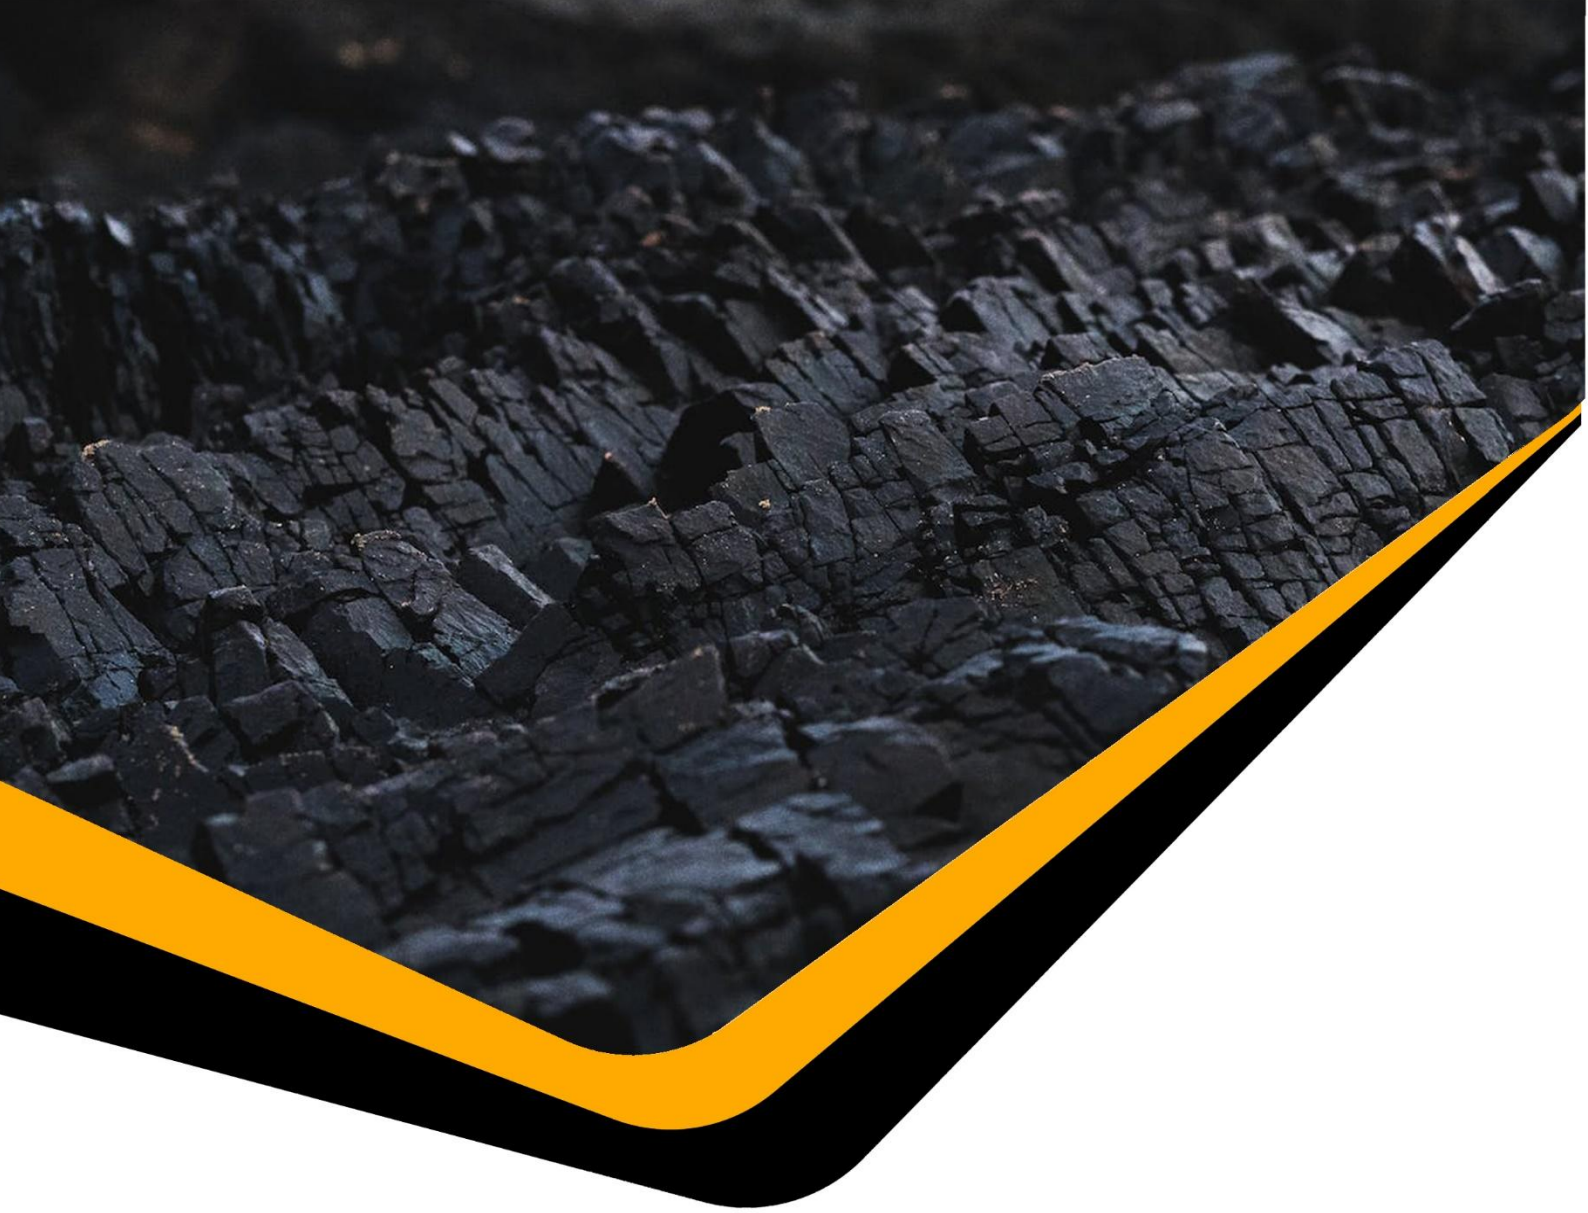

ISO 45001:2018



ISO 9001:2015



ISO 14001:2015



www.ett.mn



75055555
1800-1072



Финанс төв, 1-р хороо,
Чингэлтэй дүүрэг,
Улаанбаатар хот

