



НҮҮРСНИЙ ОВООЛГЫН ҮЗҮҮЛЭЛТ

№ ETT_SP_SSC



ISO 45001:2018



ISO 9001:2015



ISO 14001:2015



НҮҮРСНИЙ ОВООЛГЫН ЧАНАРЫН ДУНДАЖ ҮЗҮҮЛЭЛТ

НИЙТ ЧИЙГ (ar)

≤8.0%

ҮНСЛЭГ (db)

≤9.0%

ДЭГДЭМХИЙ (daf)

>28-37.0%

НИЙТ ХҮХЭР (db)

≤1.0%

БАРЬЦАЛДАХ ЧАНАР

≥75.0

НҮҮРСНИЙ ХЭМЖЭЭ

32.0

МЯН.ТН

НҮҮРСНИЙ ОВООЛГЫН ШИНЖИЛГЭЭНИЙ ҮР ДҮН

ALS GROUP LLC
Mongol National Building, 19th floor
Chinggis Avenue, Ulaan-Uul District
Ulaanbaatar, Mongolia
Tel +976 70 007867



CERTIFICATE OF ANALYSIS
25L134, L158, L192, L198, L219, L243, L293-TT

CLIENT: Erdenes Tavan Tolgoi JSC
ADDRESS: Finance Center, Jigidijsu-8
1st Khosoo, Chingelhei District
Ulaanbaatar, Mongolia
ATTN: Galtzaya.B
PROJECT NO. xxx
LAB. JOB NO. 25L134, L158, L192, L198, L219, L243, L293-TT
NO. SAMPLES: 10
Notes/Comments: xxx

SAMPLES RECEIVED: 9/12/2025 17:12/2025
INSTRUCTIONS RECEIVED: 9/12/2025 17:12/2025
DATE OF REPORT: 10/12/2025 18:12/2025
STATUS OF REPORT: FINAL
ANALYSIS COMPLETE: 10/12/2025 18:12/2025
PREPARATION CODE: CSPGC, CSPC, CSPG
ANALYSIS CODE: 1M, MOSE, ASH, VOL
TSCALE: CSSE, CKIS




These test results are representative only of the samples received in the laboratory.

LAB NO.	SAMPLE NO.	AS RECEIVED BASIS										AIR DRIED BASIS										DRY BASIS										Crucible Swelling Number (CSN)	Coal Caking Index (CKIN)
		GB/T 211		GB/T 212		GB/T 212		ISO 19579		GB/T 212		GB/T 212		GB/T 212		ISO 19579		GB/T 212		GB/T 212		ISO 19579		GB/T 212		GB/T 212		ISO 19579		GB/T 5448			
		Total Moisture (TM)	Ash (ASH)	Volatile Matter (VOL)	Fixed Carbon	Total Sulphur (TSUL)	Moisture (MOIS)	Ash (ASH)	Volatile Matter (VOL)	Fixed Carbon	Total Sulphur (TSUL)	Ash (ASH)	Volatile Matter (VOL)	Fixed Carbon	Total Sulphur (TSUL)	Ash (ASH)	Volatile Matter (VOL)	Fixed Carbon	Total Sulphur (TSUL)	Volatile Matter (VOL)	Fixed Carbon	Total Sulphur (TSUL)	Volatile Matter (VOL)	Fixed Carbon	Total Sulphur (TSUL)	Volatile Matter (VOL)	Fixed Carbon	Total Sulphur (TSUL)	Volatile Matter (VOL)	Fixed Carbon	Total Sulphur (TSUL)		
1	25353409	7.68	7.49	30.88	53.93	0.57	1.26	8.01	33.02	57.49	0.61	8.11	33.45	58.44	0.62	34.41	63.59	0.67	7.0	86	6.1	3.3											
2	25354109	7.13	8.11	30.82	53.94	0.66	1.01	8.64	32.85	57.50	0.70	8.73	33.19	58.08	0.71	34.36	63.64	0.78	7.0	86													
3	25357311	7.44	3.31	33.68	55.56	0.90	1.27	3.53	35.93	59.27	0.96	3.58	36.39	60.03	0.97	37.74	62.26	1.00	7.5	94													
4	25357412	7.32	7.01	31.01	54.66	0.53	1.05	7.48	33.11	58.36	0.57	7.56	33.46	58.98	0.58	36.20	63.80	0.62	7.0	89													
5	25359613	5.73	9.79	30.79	53.69	0.58	0.96	10.28	32.38	56.41	0.61	10.38	32.66	56.96	0.61	36.45	63.55	0.68	7.0	85													
6	25359713	5.60	7.08	32.38	54.94	0.65	0.97	7.43	33.97	57.64	0.68	7.50	34.30	58.20	0.68	37.08	62.92	0.74	7.0	85													
7	25361814	6.02	5.92	32.03	56.03	0.81	1.20	6.23	33.67	58.90	0.85	6.30	34.08	59.62	0.86	36.37	63.63	0.92	7.0	81													
8	25361914	5.71	6.35	32.12	55.83	0.57	1.08	6.66	33.69	58.57	0.60	6.73	34.06	59.21	0.61	36.52	63.48	0.65	7.0	82													
9	25366717	4.15	6.25	33.49	56.11	0.56	1.14	6.45	34.54	57.87	0.57	6.52	34.94	58.44	0.58	37.38	62.62	0.62	7.5	91													
10	25366817	4.17	7.47	32.88	55.48	0.65	1.16	7.70	33.91	57.23	0.67	7.79	34.31	57.90	0.68	37.21	62.79	0.74	7.0	87													

QUALITY ASSURANCE/QUALITY CONTROL DATA

SIDALEMS-41/25	ASH	VOL	TSUL
Certified Value	10.93	20.61	0.680
Standard Deviation	0.049	0.076	0.007
Unit	%	%	%
Analyzed value	10.89	20.58	0.684

This is the final report and supersedes any preliminary report with this certificate number. Results apply to samples as submitted. All pages of this report have been checked and approved for release. COPY REPORT PROTECTED DOCUMENT

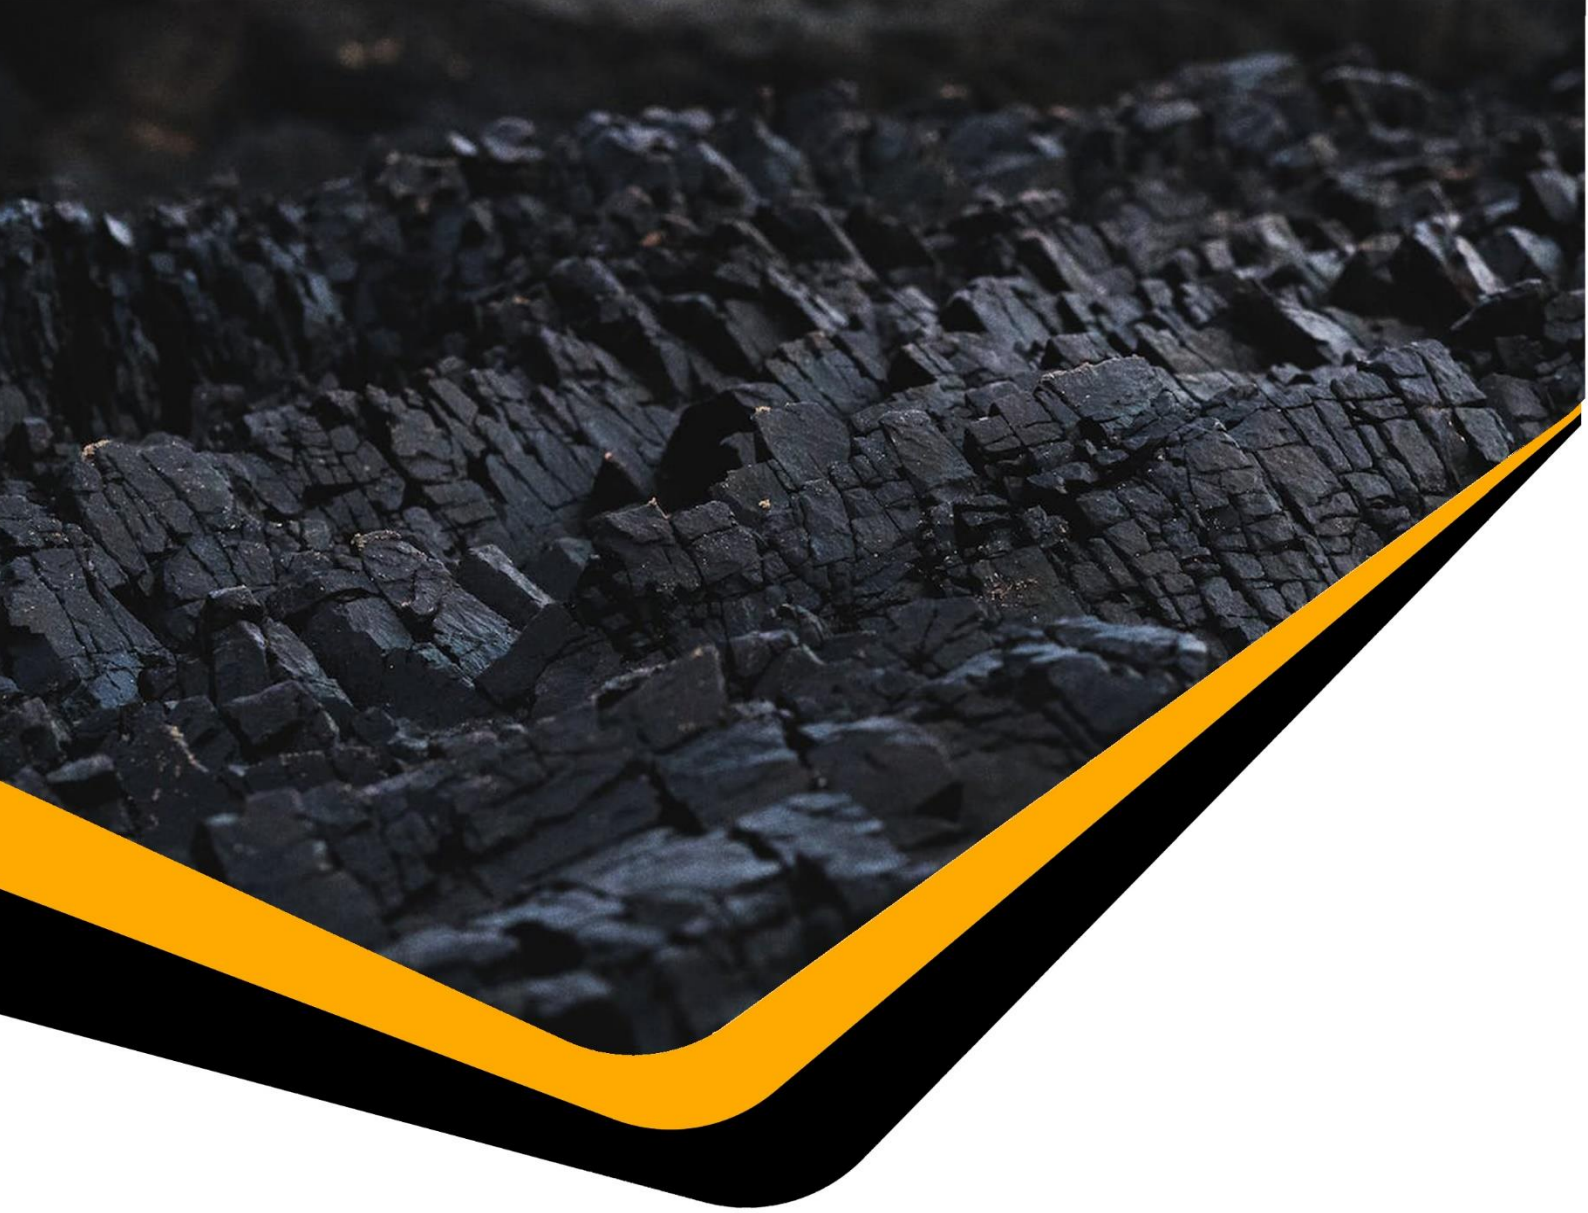

ISO 45001:2018



ISO 9001:2015



ISO 14001:2015



www.ett.mn



75055555
1800-1072



Финанс төв, 1-р хороо,
Чингэлтэй дүүрэг,
Улаанбаатар хот

